A0

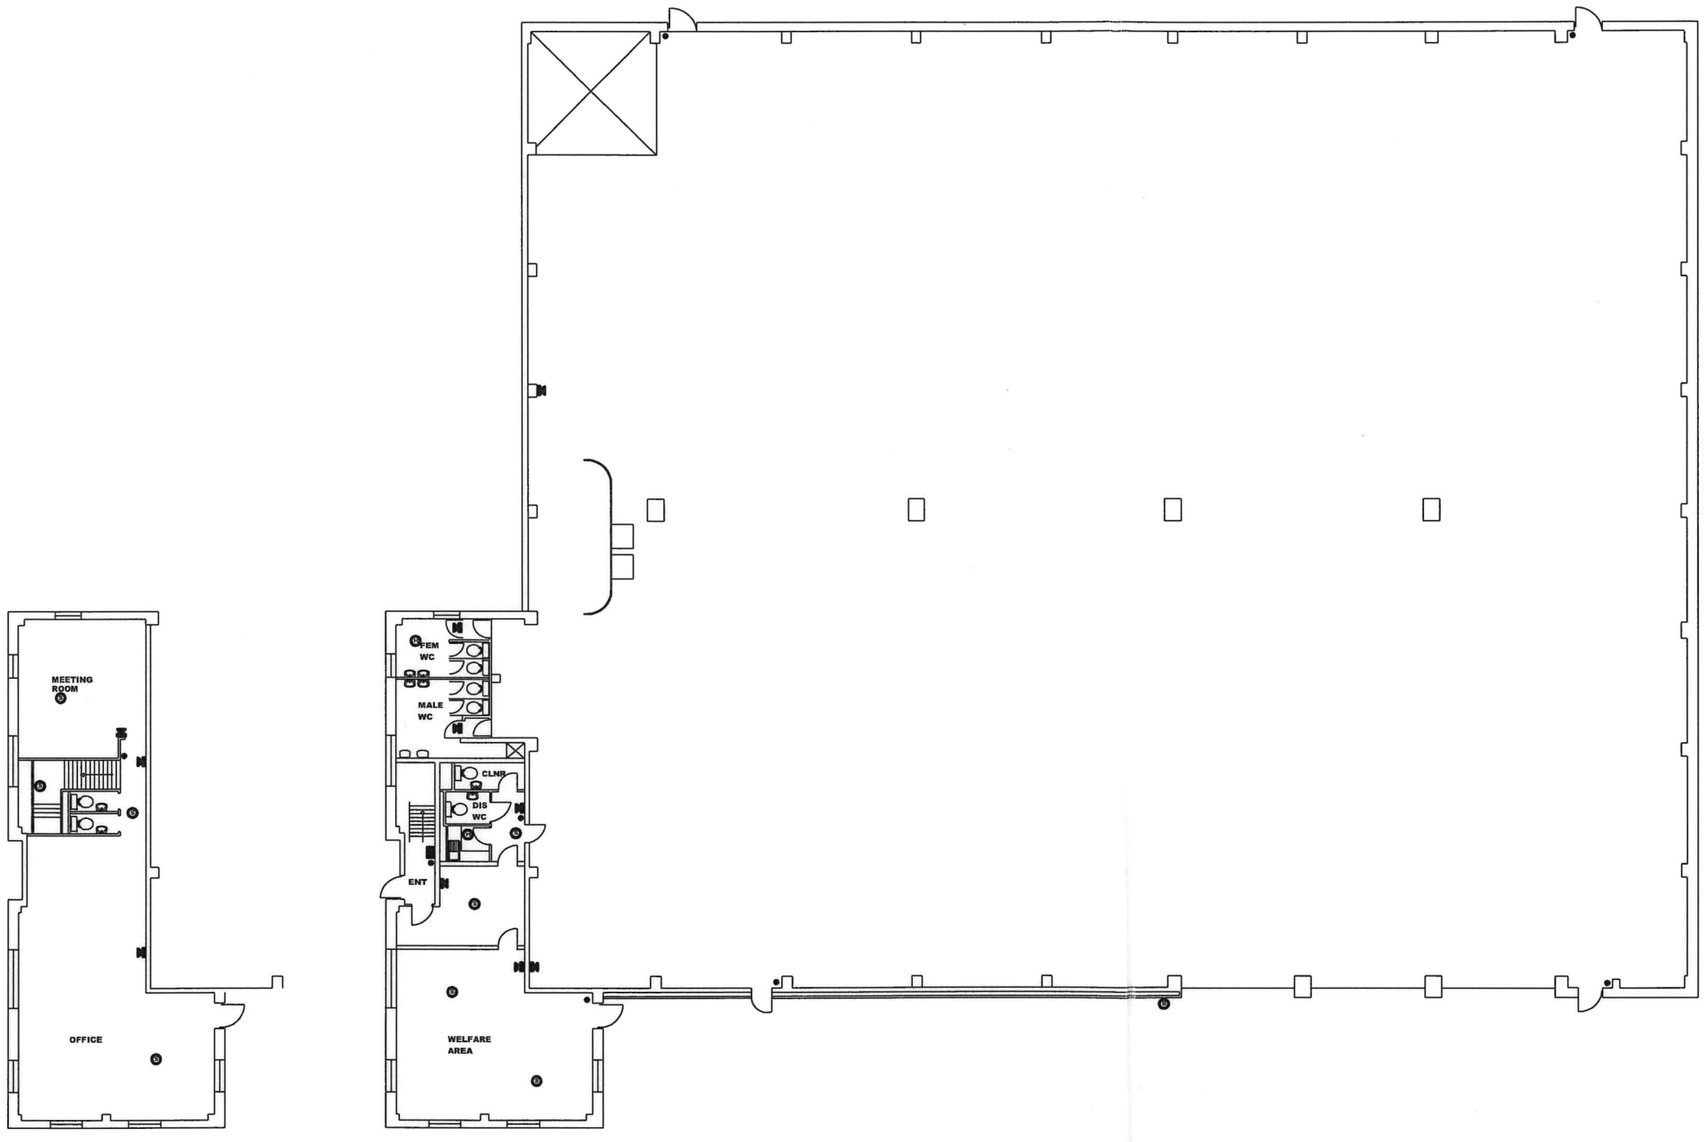

FIRST FLOOR

GROUND FLOOR

DO NOT SCALE FROM THIS DRAWING

REVISIONS

- FIRE ALARM SMOKE DETECTOR
- FIRE ALARM SOUNDER
- FIRE ALARM CALL POINT
- FIRE ALARM 4 ZONE PANEL
- FIRE ALARM HEAT DETECTOR
- EXTERNAL BELL PUSH

AS FITTED

EXTERNAL DRG REFERENCES

NAME	DRG No

APPROVAL FOR DISTRIBUTION	SIGNATURE	DATE

NOTE: SIGNATURE ON OFFICE COPY ONLY

INTEGRAL

NORRIS HOUSE
CRAWHALL ROAD
NEWCASTLE UPON TYNE
NE1 2BB
Tel: 0191 2611071
Fax: 0191 2328069

CLIENT
ROYAL MAIL

CONSULTANT
INTEGRAL LTD

PROJECT
ROYAL MAIL, POINTWEST HOUSE, KINGSWAY, TVTE, GATESHEAD

TITLE
FIRE ALARMS

Scale	Date	Drawn	Chkd
1:100 @ A0	30.09.05	PN	

Drg. No	Rev
E004	AF